



Tecumseh

VS5611W-XG1A

VS5611W-XG1A

Product Family	VS Series Scroll Compressors
Application	AC, HBP
Voltage	380-420V 3PH 50Hz, 460V 3PH 60Hz
Refrigerant	R-22, R-407C
Product Technology	Scroll





Tecumseh

1 Specification

1.1 Basic Specification

Model	VS5611W-XG1A (Including Extended Model)
Type	Low Side Shell Design Scroll Compressor
Application	Air conditioning
Refrigerant	R407C
Displacement(cc/rev)	142
Cooling Capacity(W) ^(a)	25530
Input Power(W) ^(a)	7780
RLA(A) ^(a)	14.8
Cooling COP(W/W) ^(a)	3.28
Power Supply	380-420V/3~/50Hz or 460V/3~/60Hz
Min. Operating Voltage(V)	342
Max. Operating Voltage(V)	462
LRA(A)	117
Max. Operating Current(A) ^(b)	19.7
Rated Speed(r/min) ^(a)	2900
Compressor Weight(With Oil)(kg)	53
Oil Type	POE
Oil Kinematic Viscosity(cSt, 40°C)	32
Oil Density(kg/L, 20°C)	0.977
Primary Charge(L)	2.7
Recharge(L)	2.55
Oil Circulation Rate ^(a)	≤1%
Rated Sound(Sound Power)(dBA) ^(c)	74
Max. Operating Sound in Running Envelope (Sound Power)(dBA)	79
Vibration Displacement Peak-Peak(mm) ^(d)	≤0.12
Moisture(mg)	≤1100
Impurity(mg)	≤140
LVS(V) ^(e)	323
MOV (V) ^(f)	342
Start Capacitor(μF/V)	/
Start Relay	/
Run Capacitor(μF/V)	/
IP Class of Terminal Box	IP54
Compressor Color	Black



1.2 Motor Parameters

Motor Type	Three-phase asynchronous motor
Motor Pole	2
Motor Insulation Class(°C)	130(B Class)
Line to Line Resistance UV(CS)(Ω, 25°C)	1.09(±10%)
Line to Line Resistance UW(CR)(Ω, 25°C)	1.09(±10%)
Line to Line Resistance VW(SR)(Ω, 25°C)	1.09(±10%)
Dielectric Strength	2000VAC / 1s / 50Hz, Leakage Current≤5mA
Insulation Resistance(MΩ)	≥20
Ground Resistance(Ω)	≤0.1

1.3 Safety Operating Limit

Tightness Test Pressure(MPa)	3.8-4.0
Max. Operating Pressure	
High Side(MPa)	H3.0/L2.0
Low Side(MPa)	
Compressor FreeSpace(Without Oil)	
High Side(L)	H0.9/L6.5
Low Side(L)	
Max. Refrigerant Charge(kg)	See Notes
Discharge Temperature Limit(°C)	≤125 (120mm to compressor discharge connection and well insulated)
Start-Stop Interval	See Notes

Performance Condition:

Condition	Condition Description
a	Rated Condition
b	Max. Load Condition, 90% Rated Voltage
c	Rated Condition, A Weighted Sound Power
d	Rated Condition, Max Operating Normal Displacement of Compressor Housing
e	Discharge Pressure and Suction Pressure: Saturated Refrigerant Pressure at 40°C
f	Max. Load Condition



Tecumseh

2 Rated Condition, 48 Hours Break-in-Running before implementing Performance and Sound Testing

Item	Rated Condition	Max. Load Condition
E.T.(°C)/C.T.(°C)/S.H.(K)/ S.C.(K)/A.T.(°C)	7.2/54.4/11.1/8.3/35	11.9/65.5/11.9/8.3/46.1
Cooling Capacity Deviation	≥95.0%	-
Power Deviation	≤105.0%	-
COP Deviation	≥95.0%	-

3 Internal Protector

Protection Method	Config	Parameter		
		Vendor	Vendor1	Vendor2
Internal Overload Protector	With	Model	35HM571-XX	
		Open Temp.(°C)	135±5	
		Close Temp. (°C)	61±9	
		Short Time Trip	87A 2-10s	A s
		Internal Pressure Relieve Valve	With	2.76-3.10MPa


4 Accessory

VS5611W-XG1A			
Item	Name	P.N.	PCS
1	Grommet	070-0003-00	4
2	Sleeve	010-0014-00	4
3			
4			
5			



5 Compressor Operating Envelope

5.1 Compressor Operating Envelope

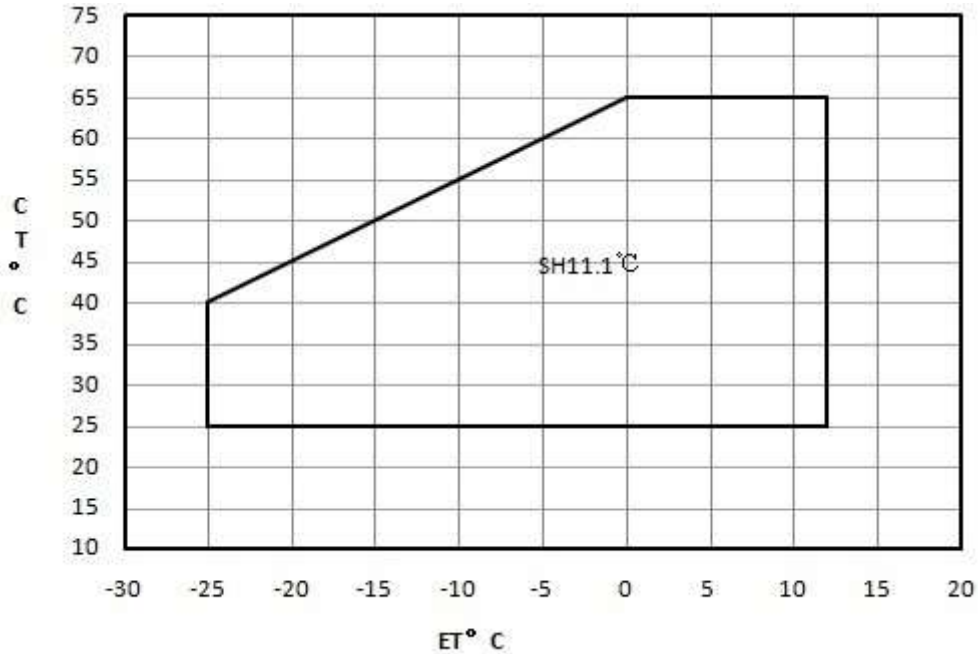

5.2 EVI control logic(only for EVI module)

- Recommend system subcooling 5K
- $DLT \leq 95^{\circ}\text{C}$, control superheat of injection line=5K
- $DLT > 95^{\circ}\text{C}$, control $DLT=95^{\circ}\text{C}$
- Max injection pressure $\leq 2.0\text{MPa}$

6 Compressor Performance Sheet

- Performance Based on Superheat is within the Operating Envelope, Subcooling after Condenser is 8.3K;
- Performance Calculated by Coefficients of Polynomial is Only Suitable for the Condition within Operating Envelope
- Capacity, Power can be Calculated by Coefficients of Polynomial



6.1 Performance Table

Item	E.T.(°C)	-20	-10	0	10
	C.T.(°C)				
Heating Cap.(W) (Cooling Cap.)	50				
	40				
	30				
Cooling Cap. (W)	50	8784	13966	20789	29634
	40	9980	15617	22994	32491
	30	11142	17151	24997	35061
Power(W)	50	6879	7027	7090	7175
	40	5480	5672	5775	5896
	30	4393	4612	4738	4879

6.2 Ten Coefficients of Polynomial

Expression	$z = p_0 + p_1*x + p_2*y + p_3*x^2 + p_4*x*y + p_5*y^2 + p_6*x^3 + p_7*x^2*y + p_8*x*y^2 + p_9*y^3$		
Description	z: Cooling Capacity(W) or Power (W) Specially: Heating Capacity(W)=Cooling Capacity(W)+Power (W) x: E.T. °C y: C.T. °C p0~p9: Coefficients of Polynomial		
Cooling Cap. Factor	Value	Power Factor	Value
p0	29843.106048	p0	2011.150232
p1	994.03136	p1	7.734044
p2	-133.46816	p2	107.063776
p3	12.563712	p3	0.021368
p4	-2.230144	p4	0.381684
p5	-0.910709	p5	-1.182606
p6	0.063491	p6	0.018086
p7	-0.049085	p7	0.001832
p8	-0.042186	p8	-0.008496
p9	-0.000829	p9	0.021455

Notes: Coefficients of polynomial are based on the fitting results of some sample data, which can be used as a reference of compressor selection, but cannot completely eliminate customer's test.



7 Notes


- 7.1 It is not allowed to perform vacuum in the system by using the refrigeration compressor. The compressor can start only after the refrigerant is charged. In some cases, such as on the field site, if it is limited by the situation that can't charge the required volume of refrigerant, 50% of the required refrigerant is charged necessary before the compressor starts. Double check the system and make sure everything is under safe status, then power on the compressor and charge the remained refrigerant when the compressor is running.
- 7.2 It is not allowed to charge the refrigerant from the suction or discharge line closer to the compressor. The charge port should be arranged on the connection pipe of suction line accumulator or receiver, which is on the side far away from the compressor, to avoid the liquid refrigerant flood back.
- 7.3 Refrigerant charge limitation: the ratio between the weight of oil and refrigerant should be ≥ 0.4 .
- 7.4 It is not allowed to vacuum by compressor, not allowed to run the compressor without refrigerant, and not allowed to run the compressor in the reversed direction for long duration.
- 7.5 The compressor can only work with approved refrigerant.
- 7.6 The compressor is not allowed to work outside its envelope, the system should guarantee the suction line superheat and avoid the liquid refrigerant flood back.
- 7.7 When the suction and discharge plugs are removed, the assembly and brazing should be done in 15 minutes.
- 7.8 The frequently start/stop should be avoided. The suggested minimum continuous running time is 10 minutes to guarantee the safe oil level ($\geq 50\%$ initial charge volume), the suggested minimum interval duration between start and stop is 3 minutes.
- 7.9 The deviation of supplied voltage should be less than $\pm 10\%$ of rated voltage.
- 7.10 A 90W crankcase heater is recommended to avoid the refrigerant migration during the off cycle and flood start. The crankcase heater should be powered on 12 hours earlier than the first start or restart after long duration off.
- 7.11 The system should be equipped with necessary protection devices, such as pressure, temperature, oil return, overcurrent and phase fault, etc.
- 7.12 The compressor is not allowed to lay down or place upside down during transportation, stock and installation. The maximum inclination is 15° when the compressor is running.



Tecumseh

8 Drawings

8.1 Outline Drawing

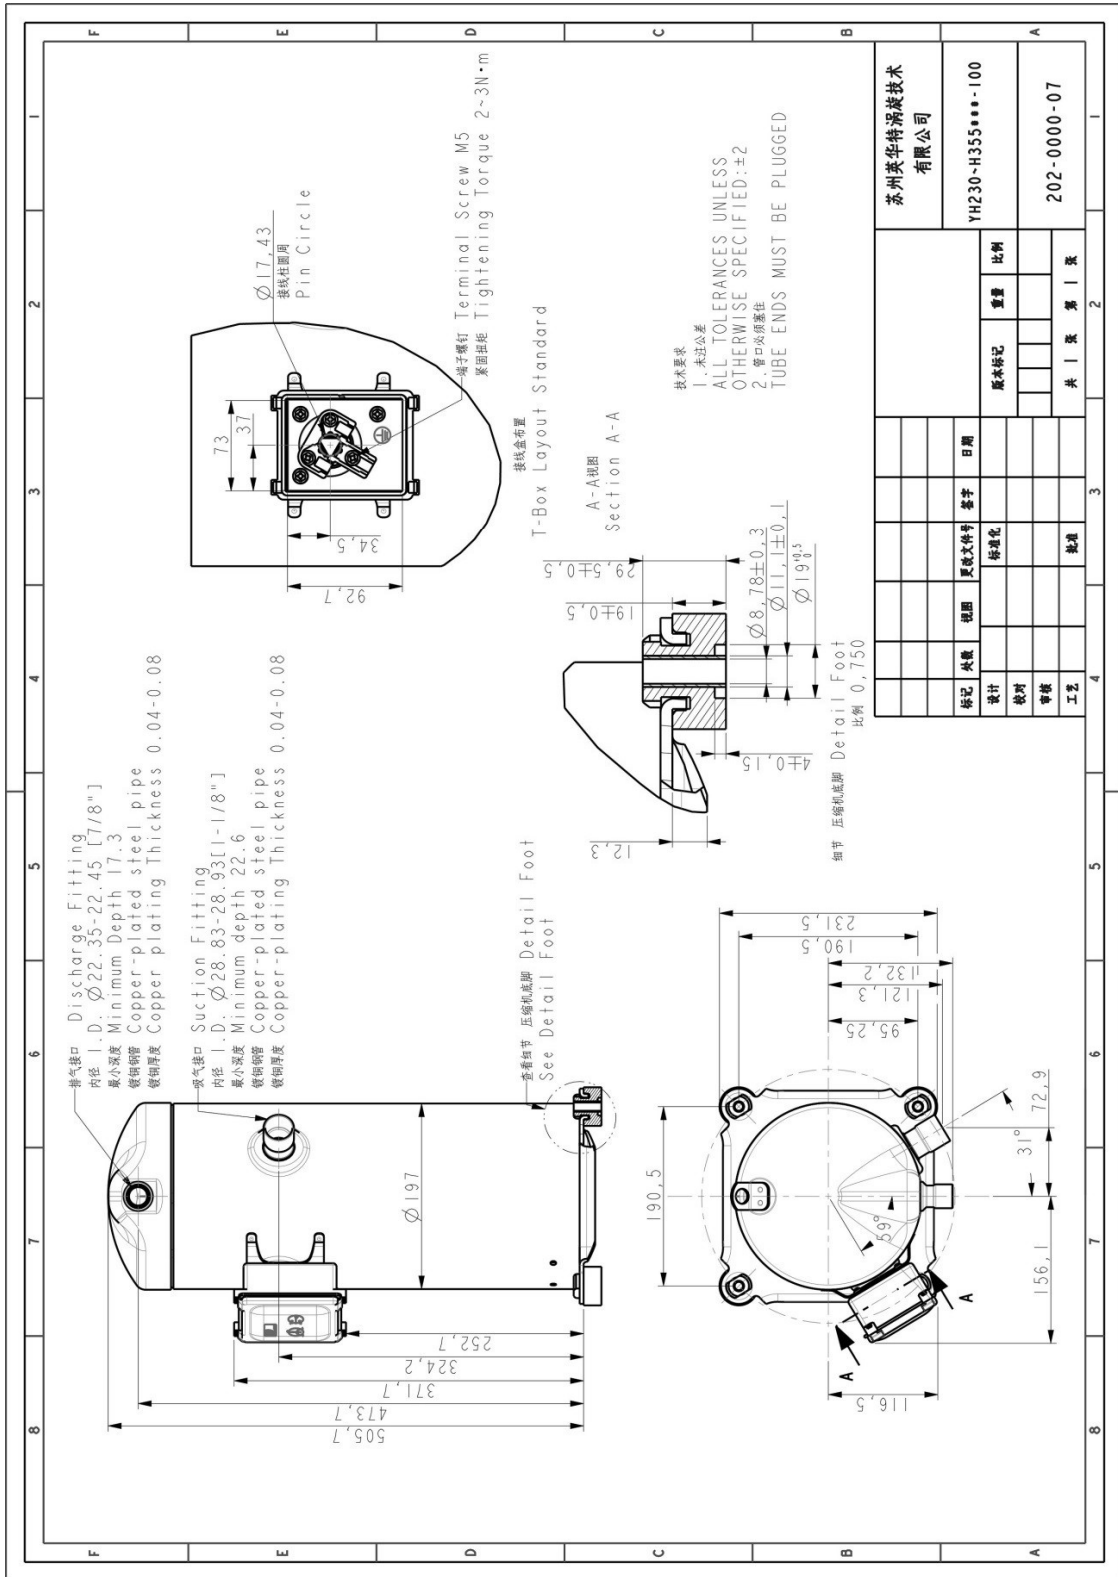



Tecumseh

8.2 Sleeve Drawing

6	5	4	3	2	1
D	C	B			
<p>技术要求：</p> <p>1. 未注单位：mm</p> <p>2. 材料：镀锌钢管； 镀锌层厚度：0.0025-0.0070mm 板厚：1.1-1.3mm；</p> <p>3. 未注公差 IT12；</p>					
		镀锌钢管		苏州英华特涡轮增压技术有限公司	
				导套	
				010-0014-00	
				共 1 张 第 1 张	
				3:1	
				D	
				重量	
				版本标记	
				比例	
				日期	
				签字	
				更改文件号	
				视图	
				标准	
				批准	
				工艺	
				审核	
				校对	
				设计	
				标记	
				外数	
				4	
				5	
				6	
				A	
				B	
				C	
				D	

